




Street Level Crescent Terrace

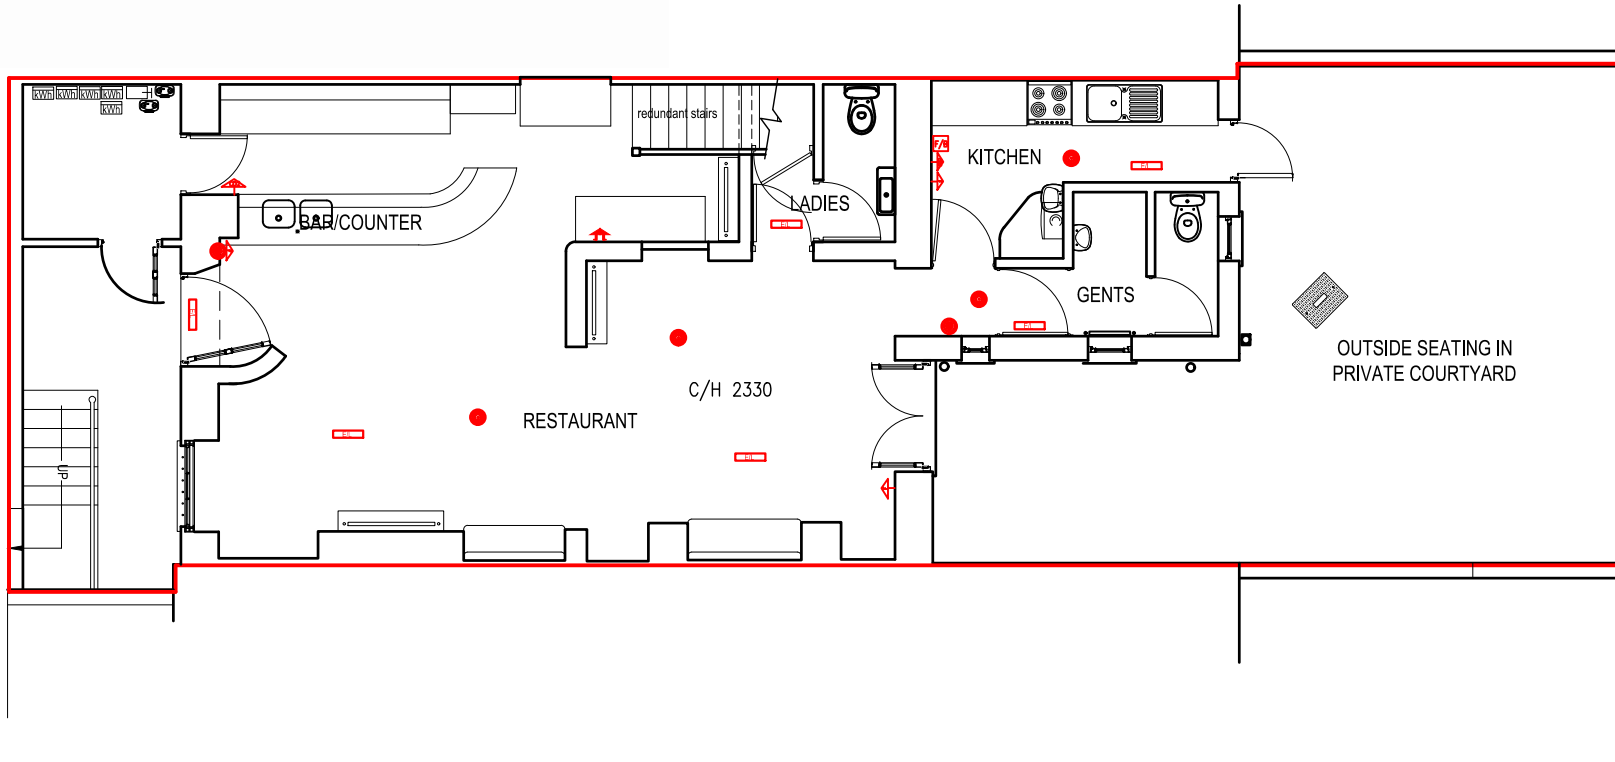

Fire Key (ALL EXISTING)

- Main Panel (ground floor shared lobby)
- Emergency lighting (maintained) to give 0.5 lux minimum to BS5266 Pt. 7/EN1838 - 4,3
- Integral emergency lighting (maintained) to give 1 lux minimum to BS5266 Pt. 1
- Lighted directional signage with integral emergency lighting (maintained) or maintained lighting above
- Call point
- Scounder
- Smoke detector
- Heat detector
- Fire blanket
- CO2
- Water extinguisher
- Foam extinguisher
- Dry powder extinguisher
- Gas Supply Isolator
- Remote Gas Shut Off (Panic Switch)

Lower Ground Floor (Basement)
 2 Crescent Terrace
 Cheltenham
 GL50 3PE

LICENSING DRAWING

Date: 17/08/2020 Scale 1:100 @ A4
 Drawing No: CD33 TCT 02b

CONAULT DESIGN

PLANNING : BUILDING REGULATIONS : INTERIOR DESIGN

6 ST CLAIR COTTAGES
 STAVERTON VILLAGE
 CHELTENHAM
 GLOUCESTERSHIRE
 GL51 0TW

TEL:01242 680827 FAX:01242 680806